


Calgary

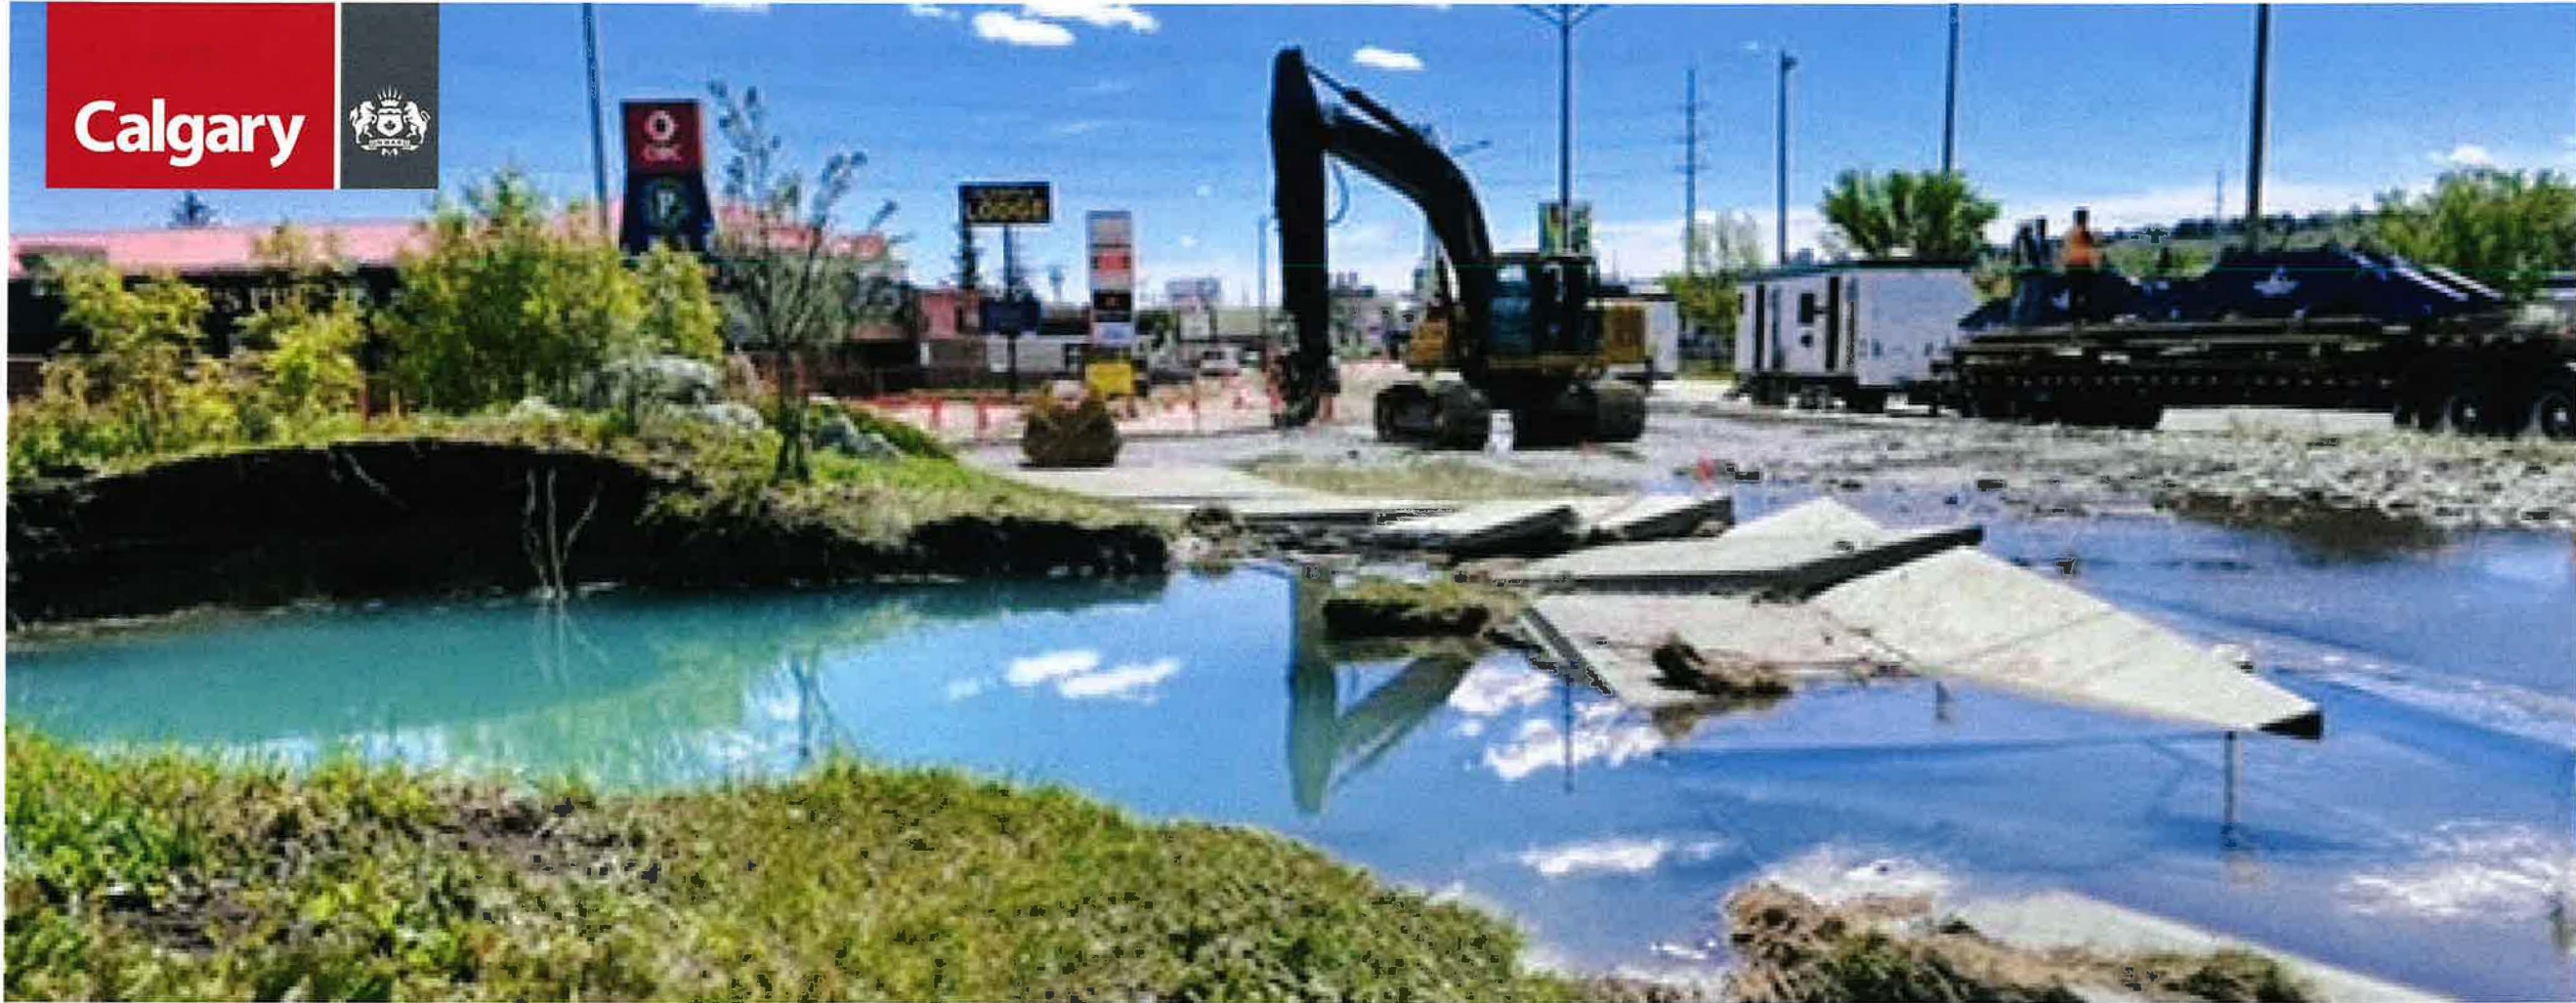

Critical Water Distribution Update: 16 Avenue Feeder Main Break

Executive Committee

2024 June 11






Recommendation



1. That Executive Committee recommend that Council receive this report for Corporate Record.



Comprehensive Emergency Management

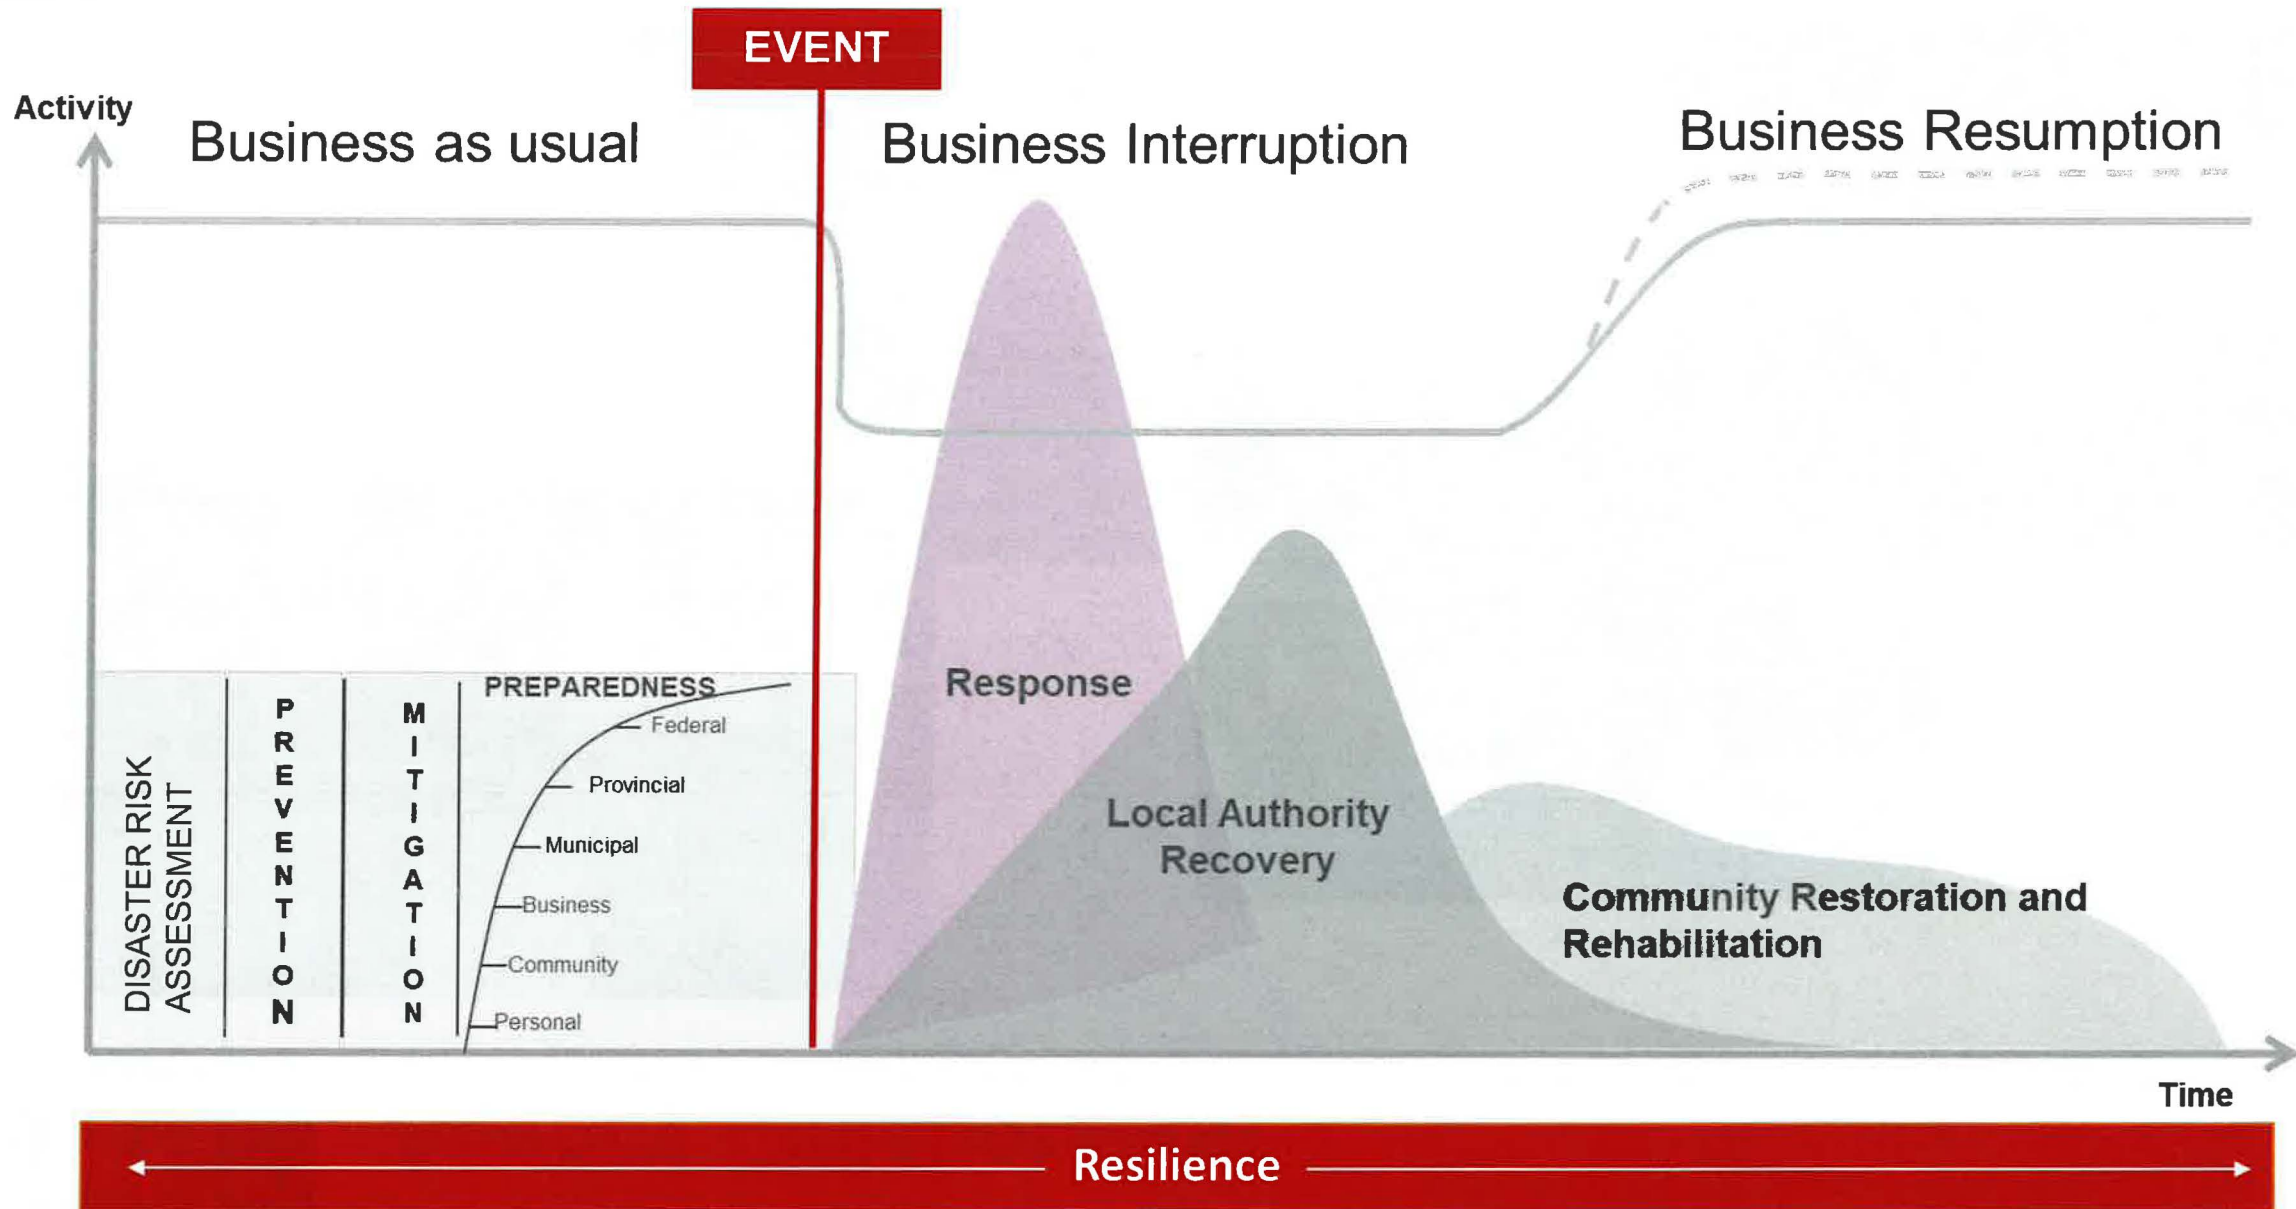



Agency Collaboration






Response Priorities & Objectives


- 1) Protecting public health & safety
- 2) Supporting repairs & water conservation
- 3) Service restoration

Situation Overview - Water

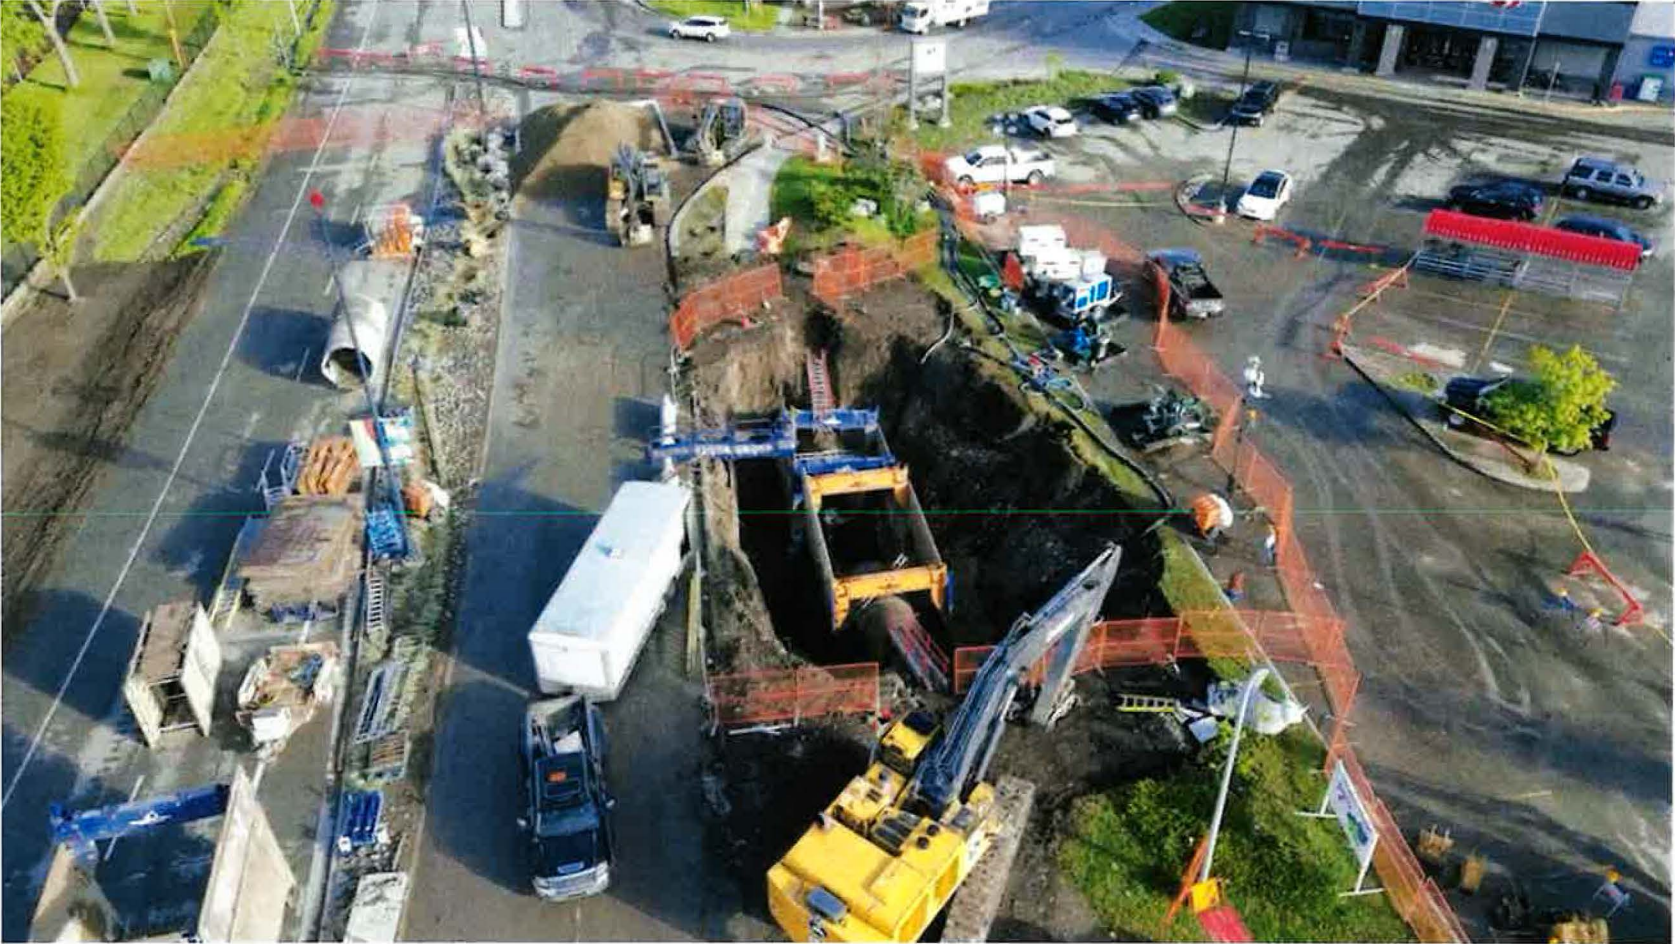




Immediate Impacts

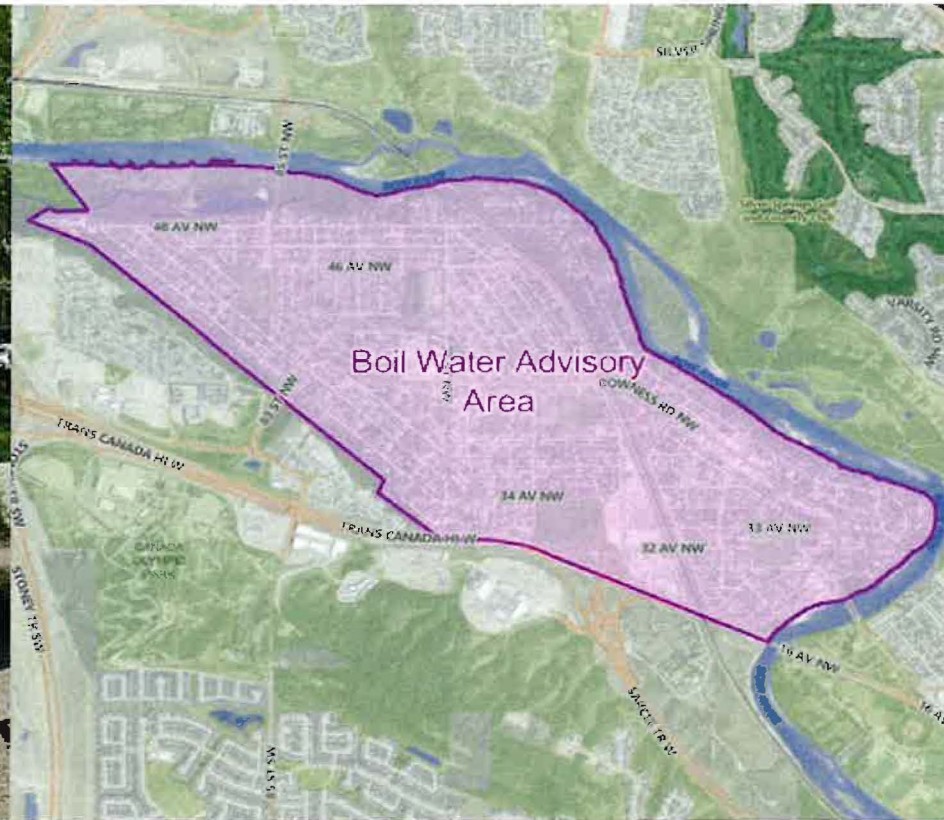




Repair Milestones

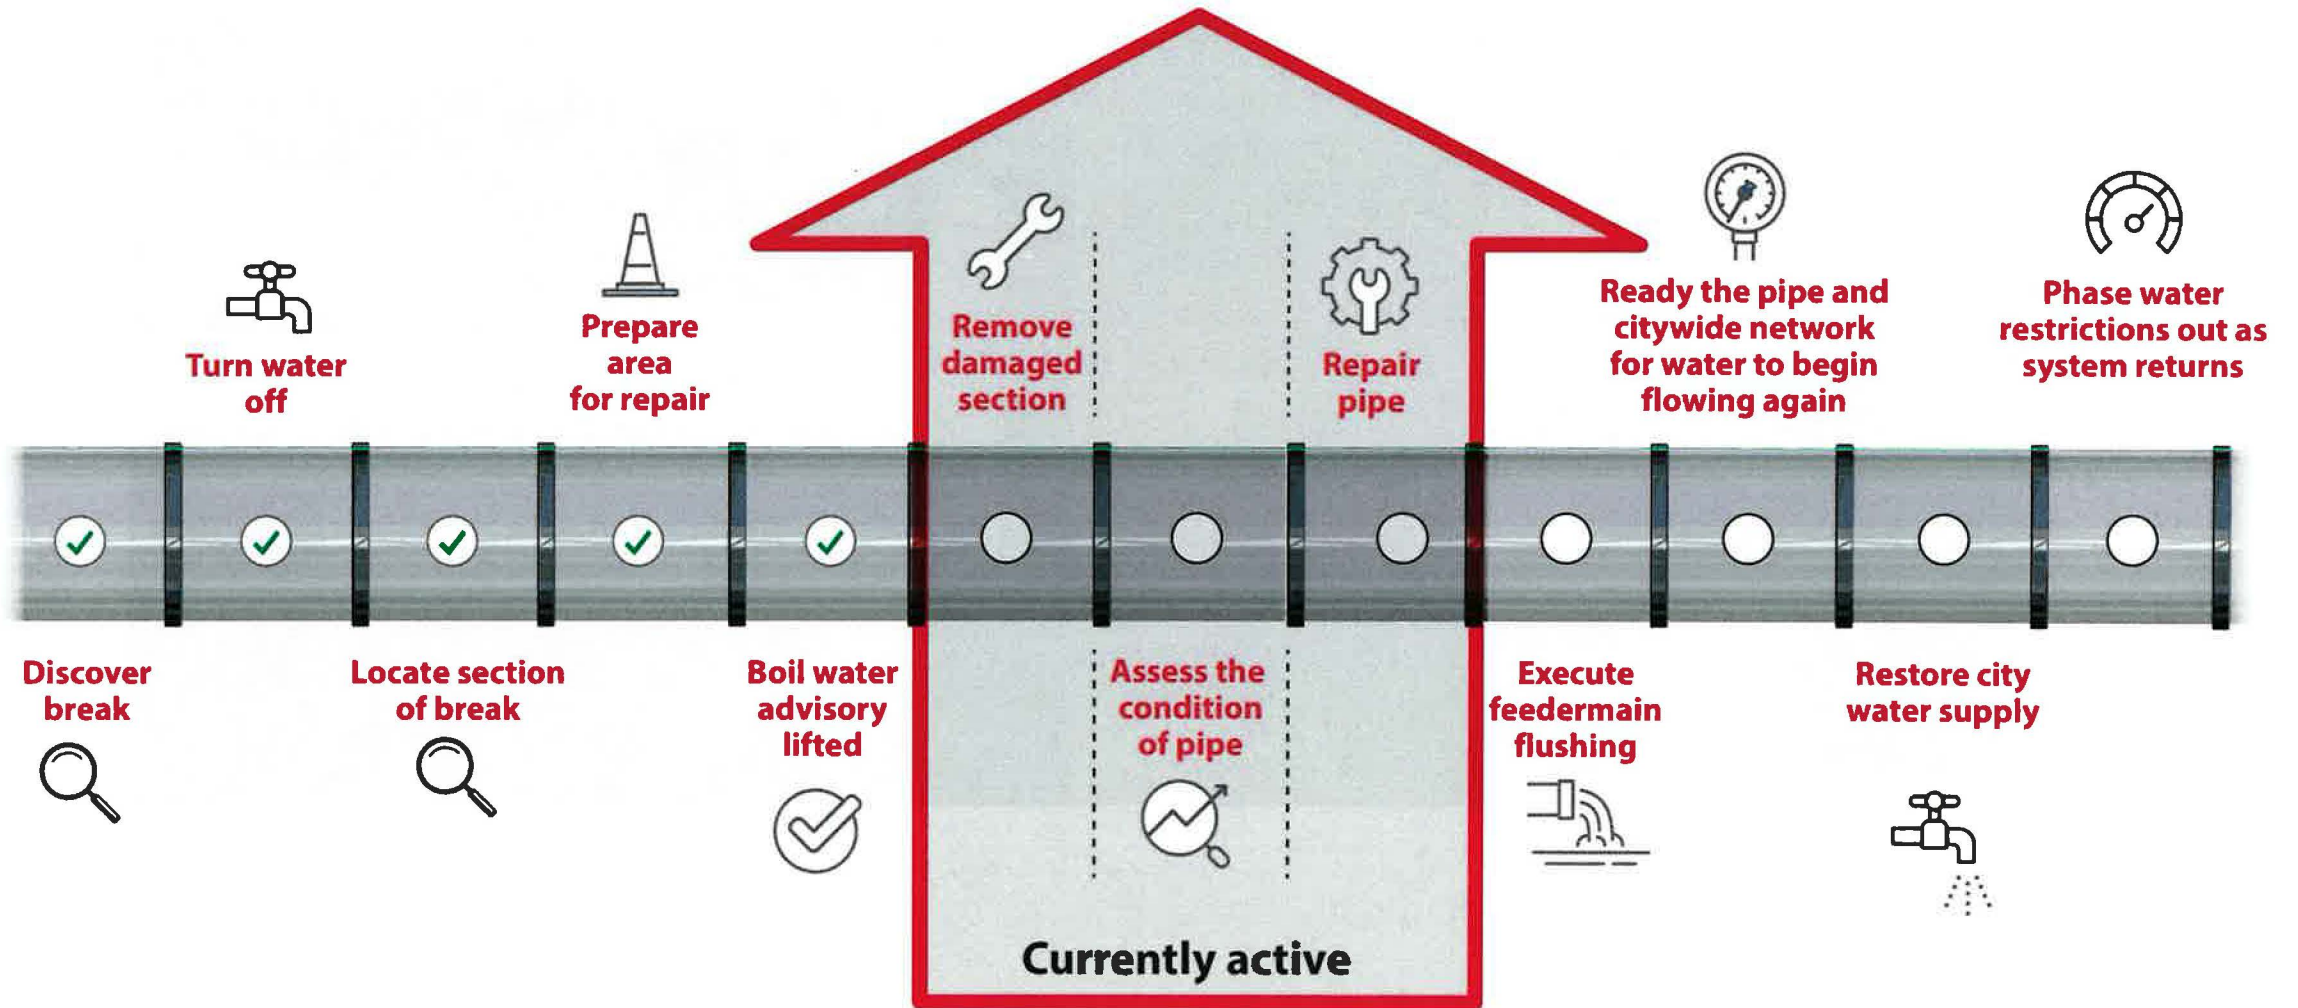




Calgarians Have Stepped Up

Every drop you've saved is making a difference

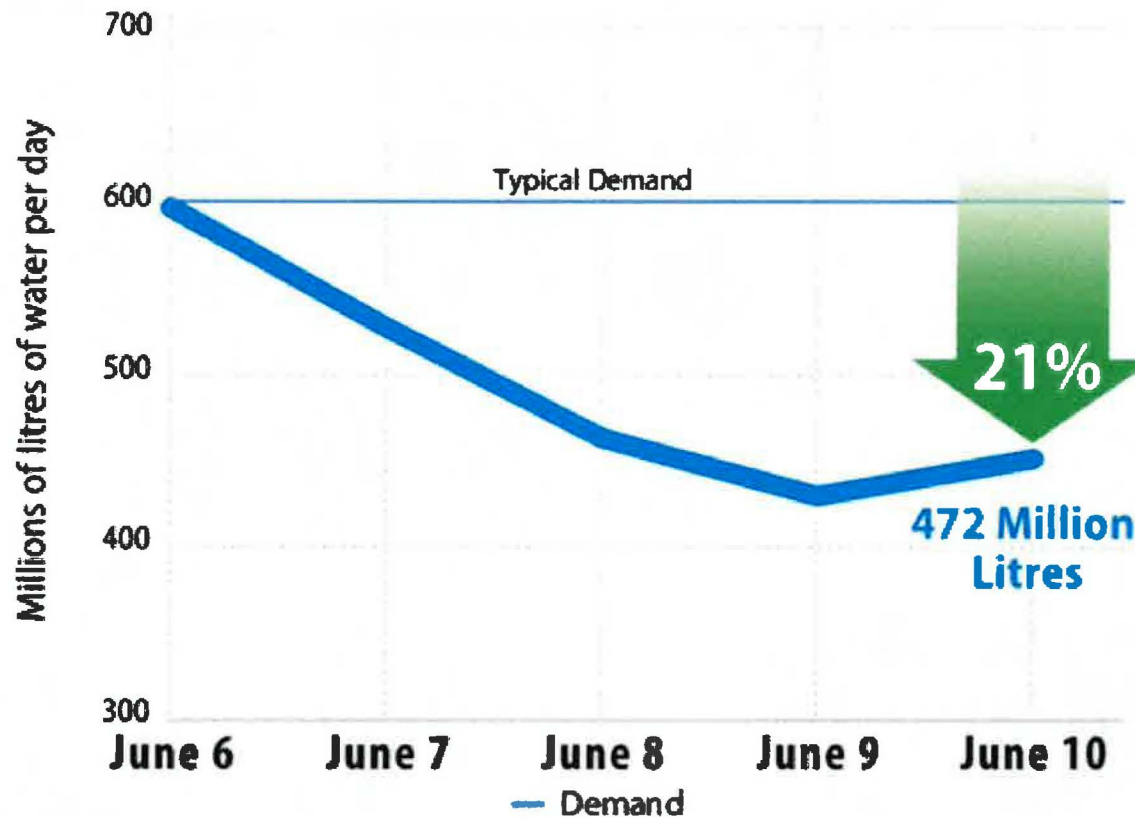


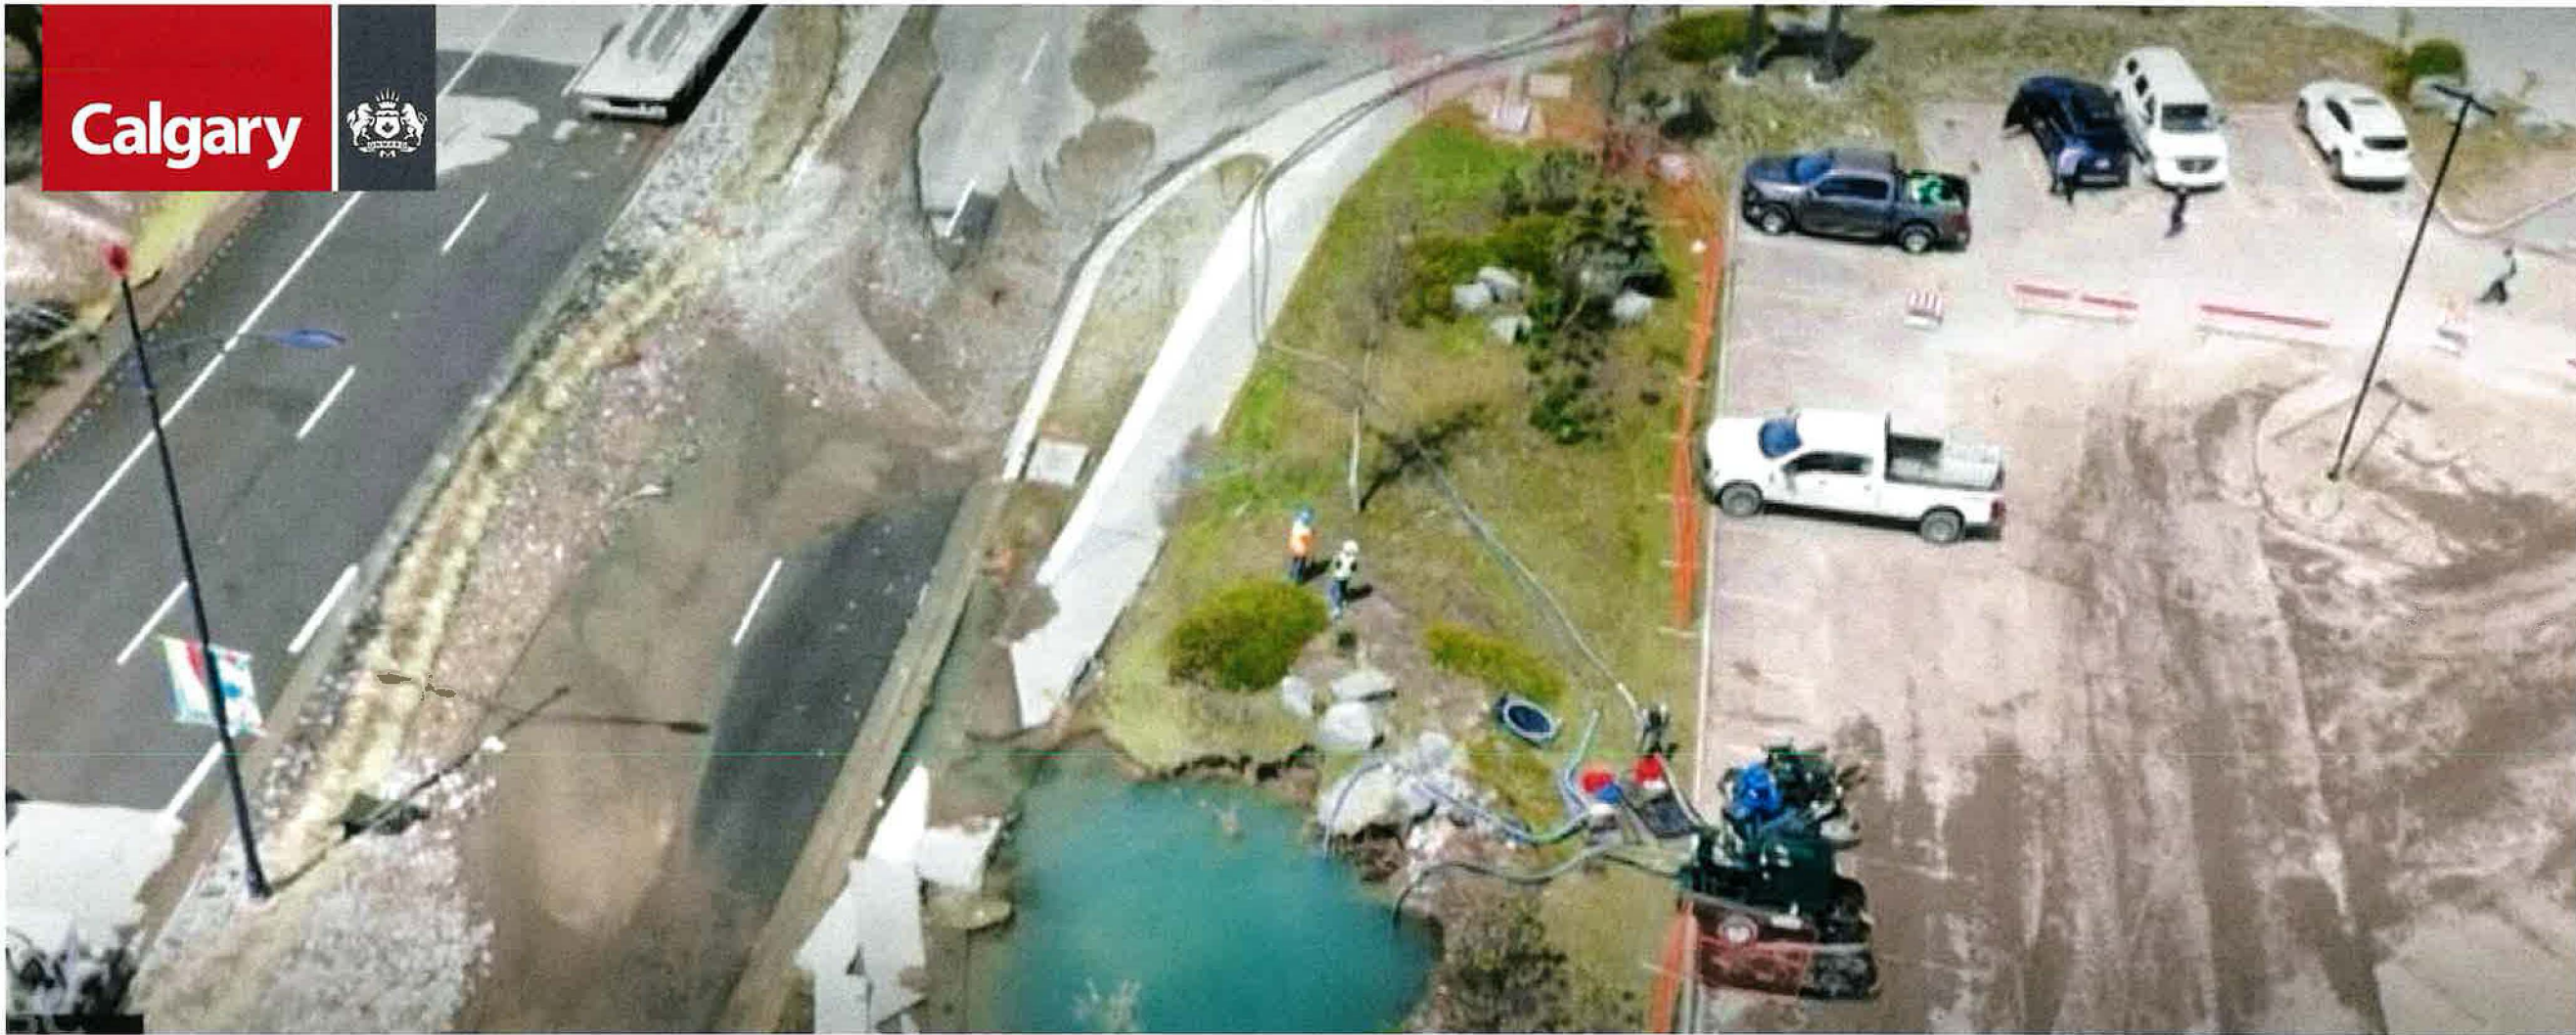

1. Recommendation: That Executive Committee recommend that Council receive this report for Corporate Record.



Communications

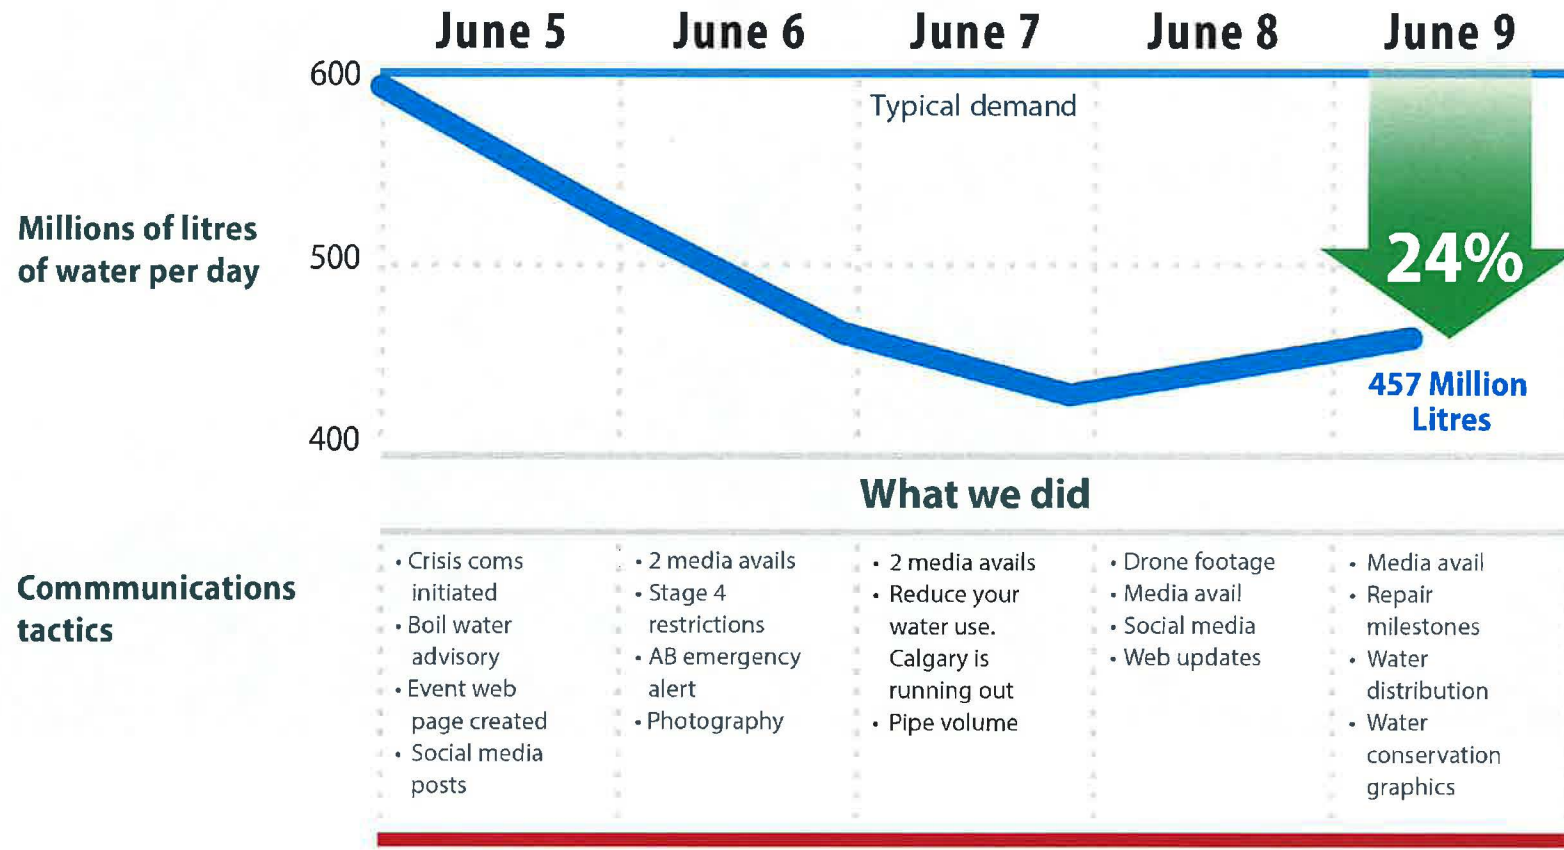

311 calls
10,236


Page visits:
423,336

Social media:
12,127
incoming messages


Media releases:
8

2024-06-11

PARTS OF A PRESTRESSED CONCRETE CYLINDER PIPE

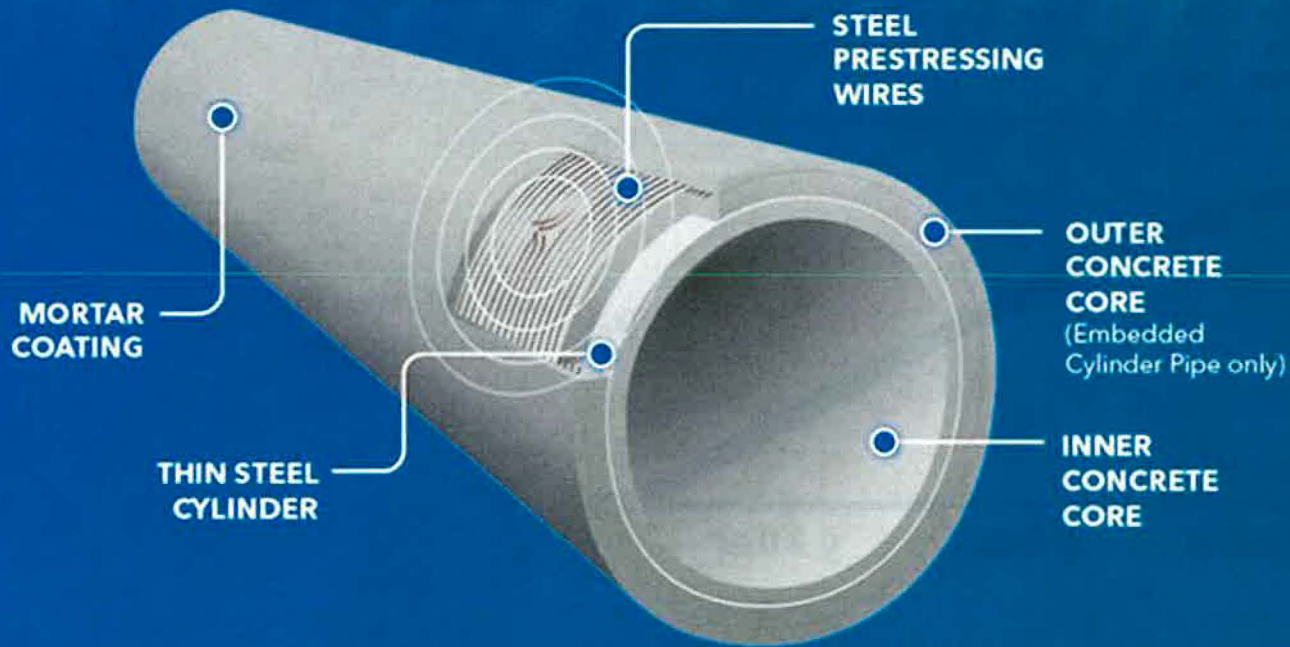





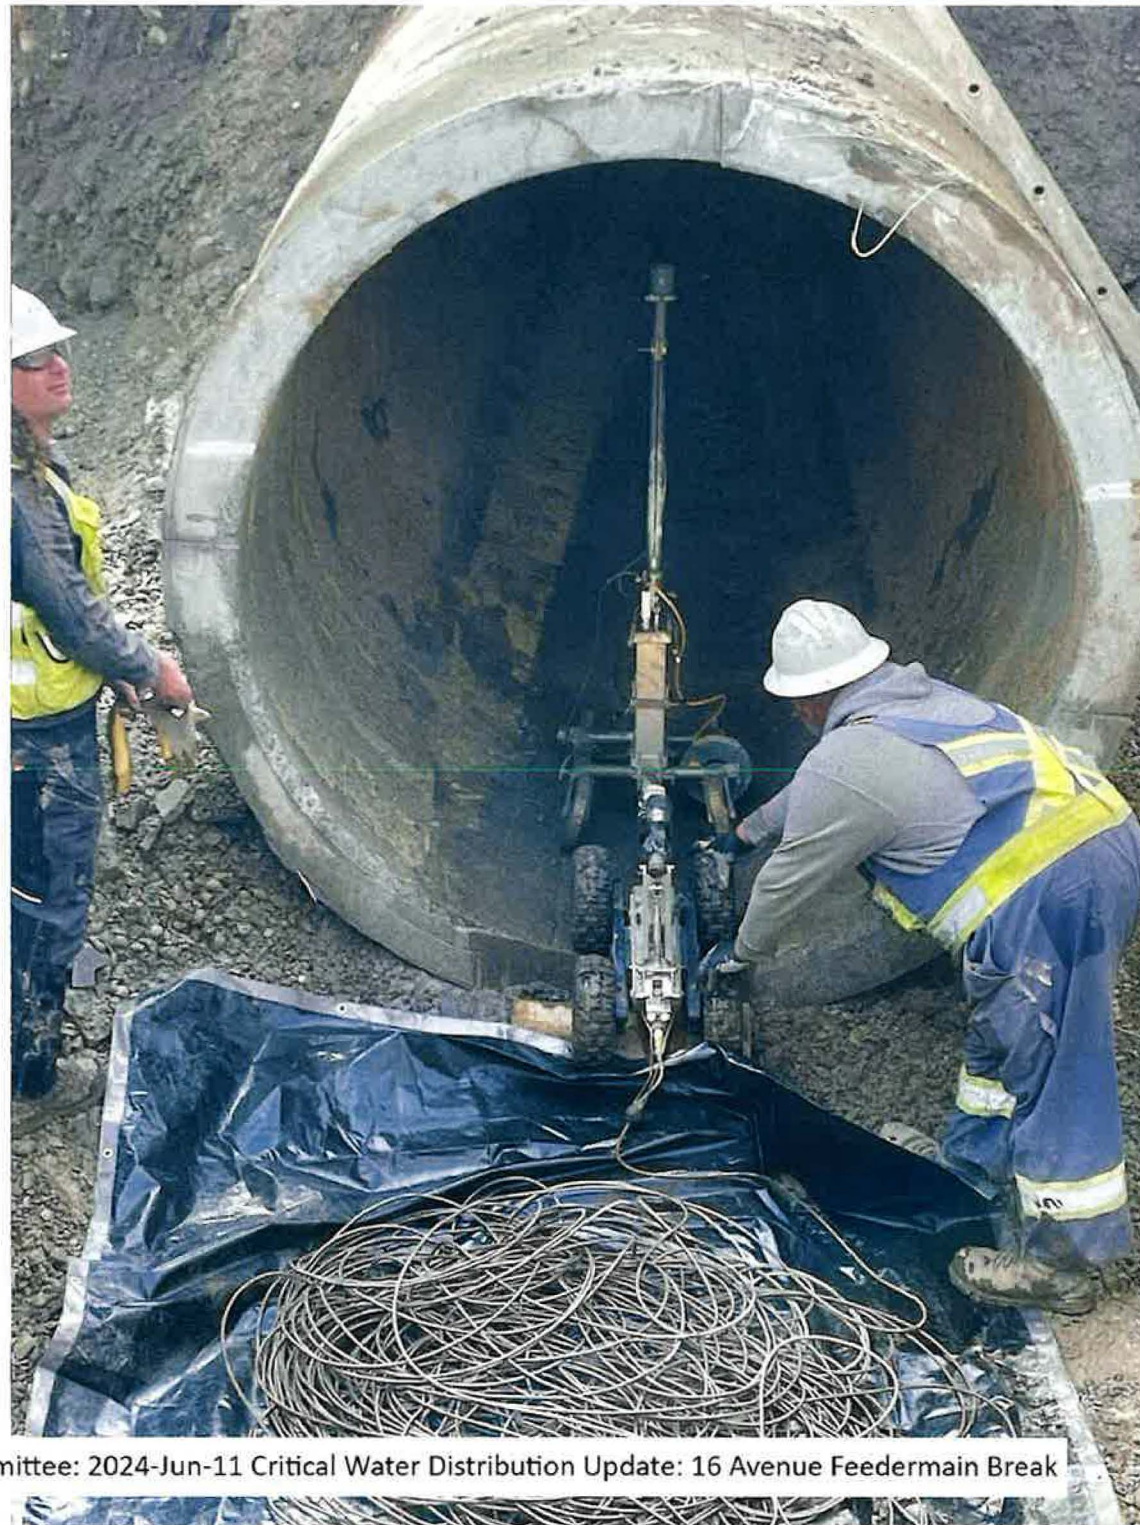

ECCommittee: 2024-Jun-11 Critical Water Distribution Update: 16 Avenue Feedermain Break




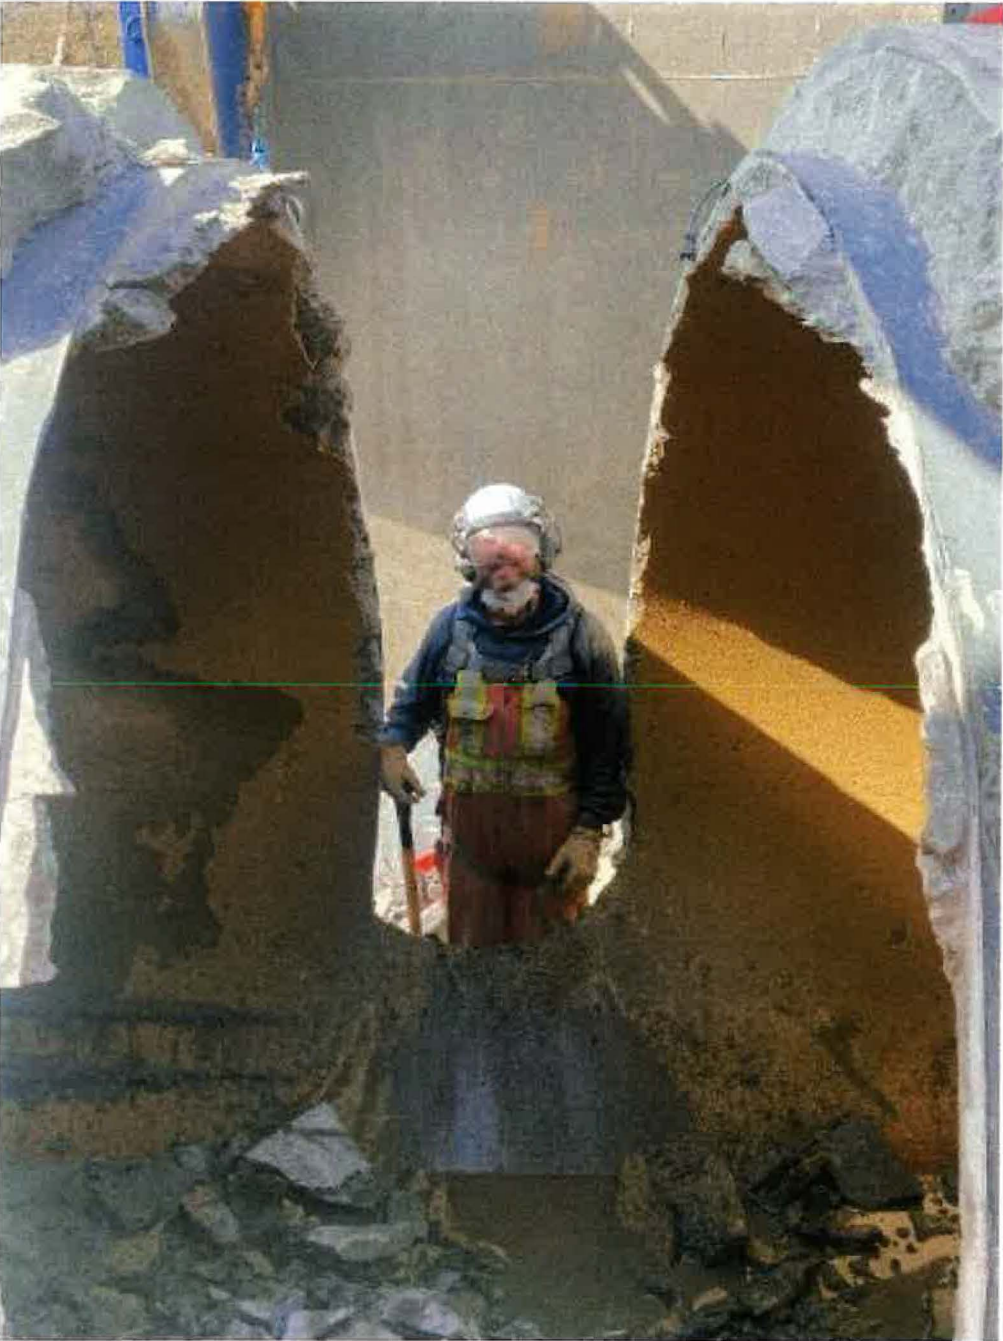

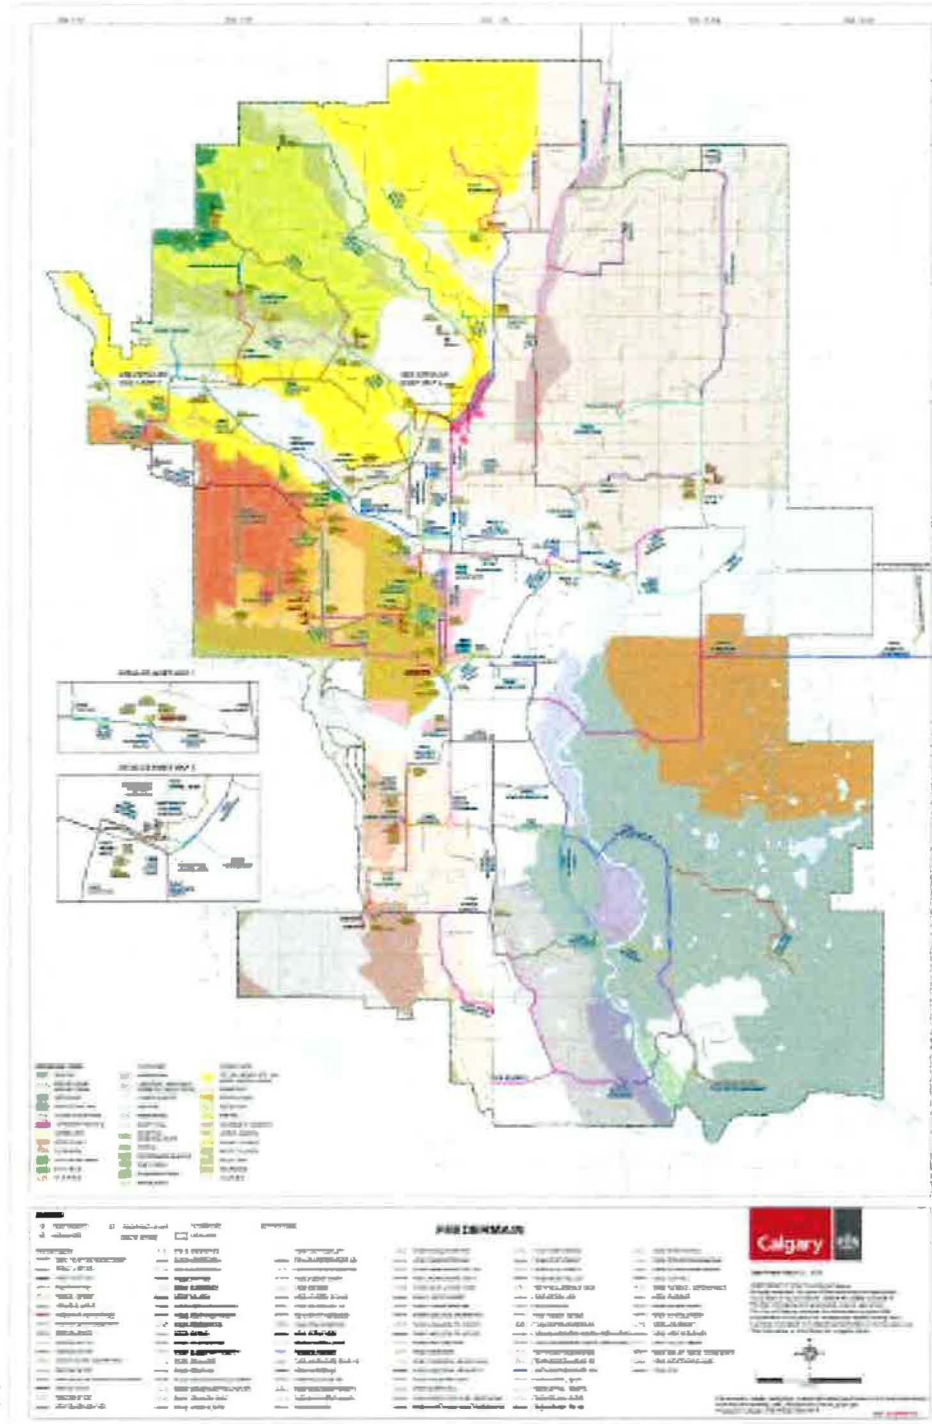




Calgary **Before** watermain break

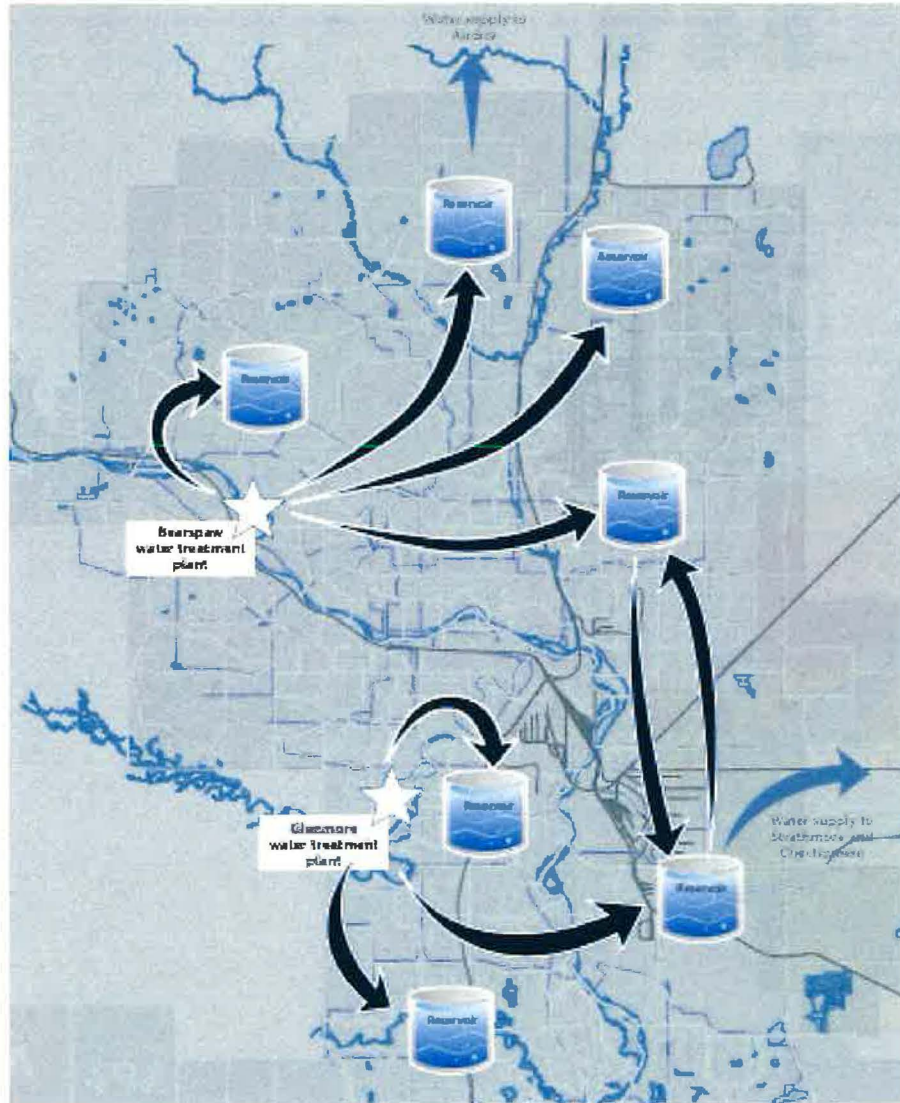

Calgary **After** watermain break

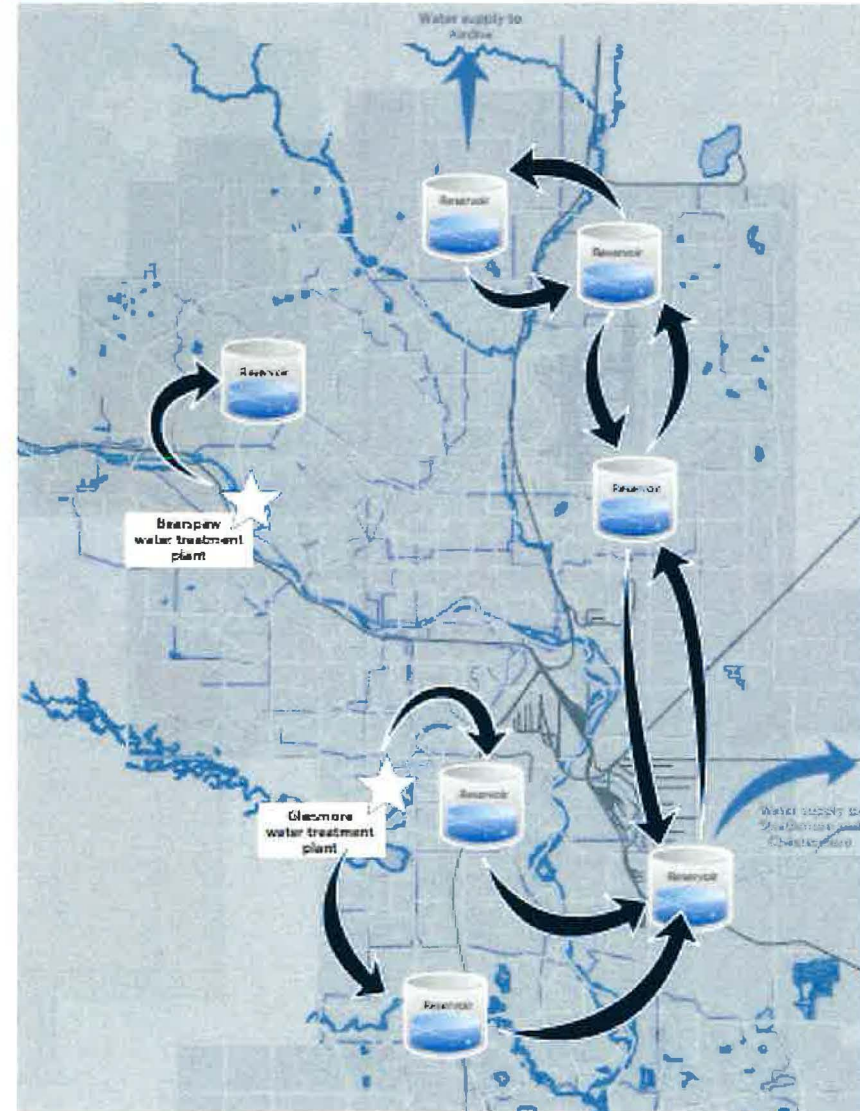



Reduce 25%



Keep showers to 3 mins or less

Reduce 25%



Do laundry in full loads only

Reduce 25%



Brush teeth with the tap off

Reduce 25%



Wash dishes on a full load only



PARTS OF A PRESTRESSED CONCRETE CYLINDER PIPE

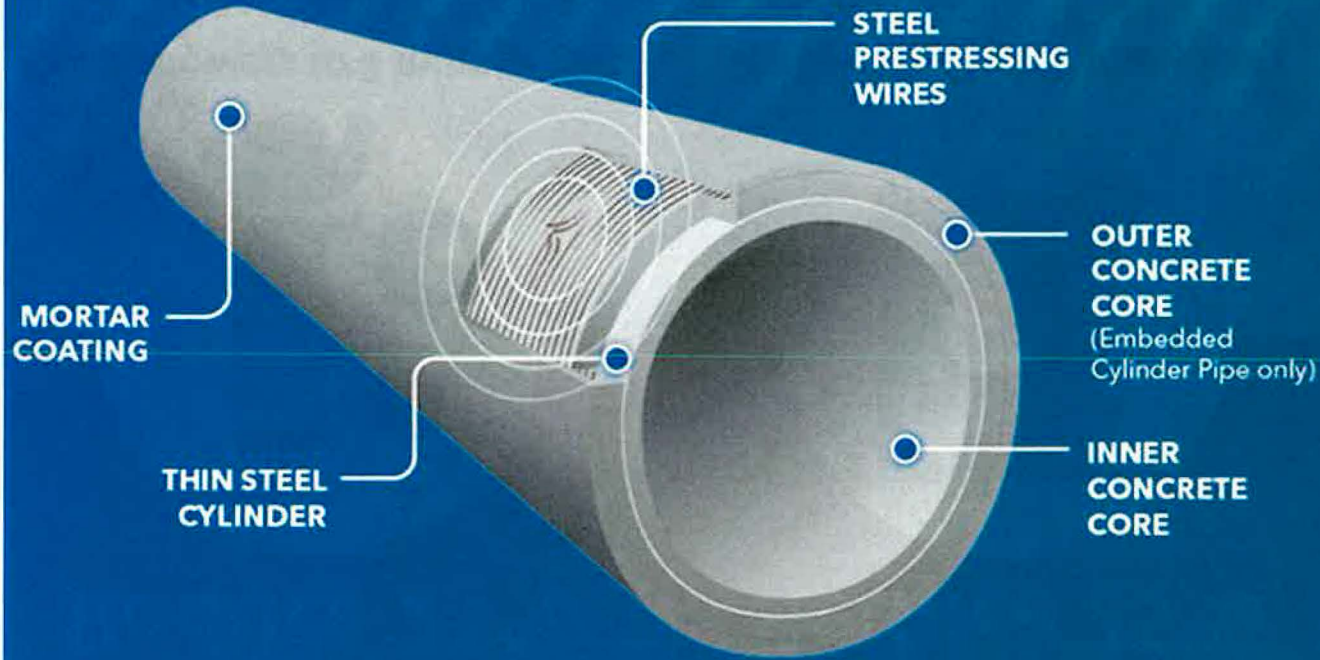


Image source: xylem.com

